8000-5750-5540-2208

TEST REPORT

1. NO : CT20-134026E
2. Client
   - ○ Name : roVa Corporation
   - ○ Address : 18F 382, Gangnam-daero, Gangnam-gu, Seoul, Korea 06232
3. Date of Test : 2020.11.23 ~ 2021.01.06
4. Use of Report : Quality control
5. Test Sample : roVa Shield PUTTY
6. Test Method
   (1) KS M 6010:2014
   (2) KS M 5000:2019
   (3) KS M ISO 11890-2:2014

Affirmation	Tested By Name : Song Seokho	Technical Manager Name : Bae Sangbok

This report is not accredited by KOLAS.
Our report apply only to the standards or procedures identified and to the sample(s) tested unless otherwise specified. The test results are not indicative of representative of the qualities of the lot from which the sample was taken or of apparently identical or similar products. The results of using only a portion of this report cannot be guaranteed. The authenticity of this test report can be checked on KCL website(www.kcl.re.kr).

2021.01.06

Korea Conformity Laboratories President Yoon, Kap Seok

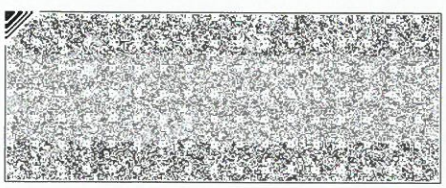
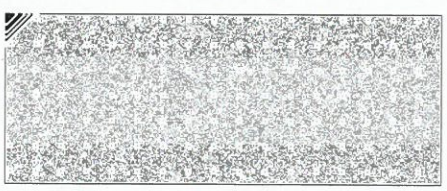
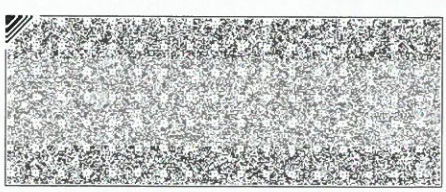

TEST REPORT

No : CT20-134026E

7. Test Results

1) roVa Shield PUTTY

Test Item(s)	Unit	Test Method	Test Results	Remark	Loc.
Drying time(Thin coated)	h	(1)	2	(23 ± 1) ℃, (50 ± 4) % R.H.	A
Drying time(Heavy coated)	h	(1)	4		
Water resistance	-	(1)	Passed	-	
Alkali resistance	-	(1)	Passed		
Adhesion strength(Thin coated)	N/㎠	(1)	101. 8	(23 ± 2) ℃, (50 ± 5) % R.H.	
Adhesion strength(Heavy coated)	N/㎠	(1)	94. 7		
Consistency	K.U	(2)	Over 141	(25 ± 0.5) ℃	
Appearance for dried films	-	(2)	Passed	(23 ± 1) ℃, (50 ± 4) % R.H.	
Working properties of paint	-	(2)	Passed		
VOC(volatile organic compound)	g/L	(3)	0.46	-	B

▶ Consistency Measuring range:(40-141) K.U

※ Location

A : 628, Sorae-ro, Namdong-gu, Incheon, 21594, Korea

B : 199, Gasan digital 1-ro, Geumcheon-gu, Seoul, Korea

----- End of Report -----
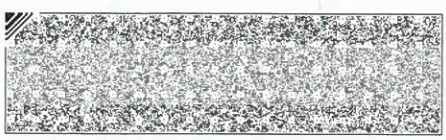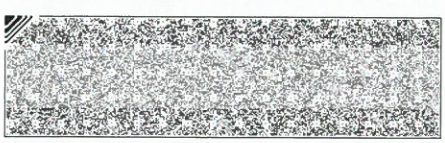
COPY 복사본